

NIGHT VENTILATION IN INDUSTRIAL BUILDINGS: A CASE STUDY

J. Guerra, J.L. Molina, E.A. Rodríguez, R. Velázquez

*Departamento de Ingeniería Energética y Mecánica de Fluidos
Universidad de Sevilla
Av. Reina Mercedes s/n
E-41012 Sevilla, Spain*

ABSTRACT. In general, industrial buildings are not designed so as to obtain reasonable levels of comfort therein. A particularly important aspect, given its contribution towards discomfort, is the lack of insulation in the building. This factor causes the interior surfaces of the enclosure to reach extremely high temperatures. This paper presents an analysis of the thermal conditions in an industrial building, carried out with a view to improving the level of comfort inside the building by means of a combination of night ventilation and selective insulation techniques. In its original state, the temperature inside the building at the height of Summer surpassed 40°C . The S3PAS computer programme enabled us to reveal the source of the problem. At the same time, we were able to simulate the thermal behaviour deriving from each passive cooling measure, prior to final implementation, and thereby select the most suitable one for the usage of the building. Monitoring of the building, once the proposed measure was implemented, reveals a close approximation between the results forecast by S3PAS and those actually obtained. A reduction of the interior temperature to a maximum of 34°C was achieved.

1. Introduction

In general, industrial buildings are not designed so as to obtain reasonable levels of comfort therein. A particularly important aspect, given its contribution towards discomfort, is the lack of insulation in the building. This factor causes the interior surfaces of the enclosure to reach extremely high temperatures, especially in the roof which is one of the main contributors to both, the thermal load of the building, and the discomfort of the occupants.

Construcciones Aeronáuticas S.A. have, at their Seville factory, industrial buildings, without air conditioning systems, inside which the temperature surpasses 40°C on the hottest days of the Summer. In this paper we study the levels of comfort within one of these buildings and of the possible passive cooling techniques which would lead to a reduction in the resultant inside temperature.

The problem was analyzed with the aid of the S3PAS computer programme [1]. The building was simulated, with the outdoor conditions pertaining on a severe Summer's day, as laid down by Spanish regulations, in its original state and following implementation of a series of passive cooling techniques. The simulations performed revealed the source of the problem and enabled us to select the most suitable technique considering the usage of the building.

Table 1: Areas by Orientation (m^2)

	SE	SW	NW	NE	Roof	Floor
Warehouse	297 ^a	175 ^a +50 ^b	225 ^e	225 ^a	1250 ^c +125 ^d	1364 ^f
Printing Works	75 ^a	225 ^e	200 ^a +25 ^b	200 ^a +25 ^b	300 ^c + 40 ^d	286 ^f

Table 2: Constructional Features

Walls	U ($W/m^2 K$)	Weight (kg/m^2)	Areas (m^2)
^a Exterior	1.47	376.	1172.
^b Metal doors	5.8	–	100.
^c Roof	0.72	96.	1550.
^d Skylights	4.30	–	165.
^e Partition	3.31	122.	450.
^f Floor	1.74 W/mK	480.	1650.

2. Description of the Building. Original State

The building under study [2] is an industrial building of approximately 1650 m^2 , forming a 31×55 m rectangle. The main axis runs NE-SW. All the enclosing walls are exterior with the exception of the NW one which is adjacent to an air-conditioned office building.

The building is divided into two areas: a Warehouse of approximately 1300 m^2 and a Printing Works which occupies some 350 m^2 . The average height of the building is 7.3 m . The area of each confining surface is shown for each orientation in Table 1. The construction features are shown in Table 2.

The building is occupied by 6 to 8 people when in use, which is from 5 to 14 hours (solar time). During this period the illumination is 0.88 W/m^2 in the Warehouse and 3.52 W/m^2 in the Printing Works, where there is equipment with an installed capacity of 37 kW .

The Warehouse area is naturally ventilated whereas in the Printing Works there is forced ventilation by fans which renew the air 6 times each hour. The doors are open when the premises are occupied.

3. Methodology

The S3PAS programme was used to simulate the interior conditions of the building on a design Summer's day in Seville (percentile 1 %), both at a constant interior temperature and allowing this to fluctuate freely. The former conditions enable us to ascertain which constructional aspects influence the thermal load to a greater extent. The latter permit comparison of the simulated and actual interior conditions, given that the building has no air-conditioning equipment, in two main steps:

1. Check of the correct definition of the building, by comparing the results of sim-

Table 3: Principal Load Components (*kwh* per day)

	Printing Works	Warehouse	TOTAL
Conduction (Roof)	218	909	1127
Conduction (other Walls)	217	535	752
Radiation	47	194	241
Occupancy	2	6	8
Illumination	14	15	29
Equipment	370	0	370
Ventilation	81	57	138
TOTAL	949	1716	2665

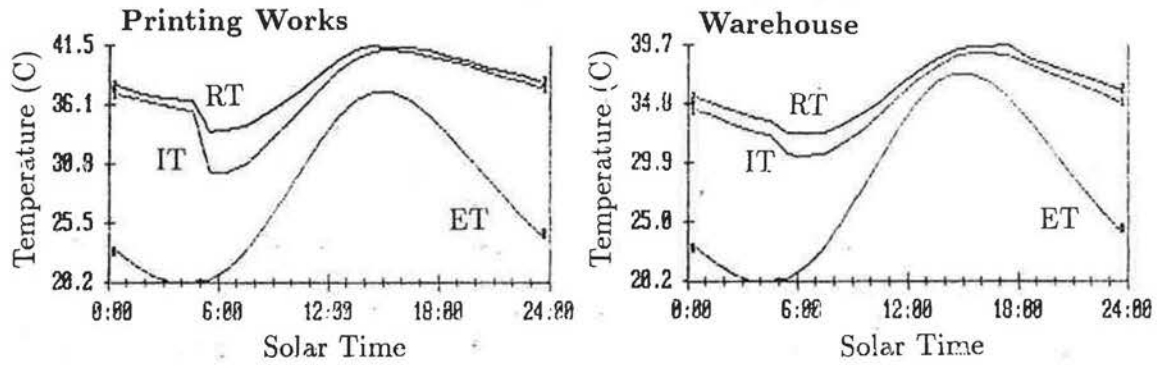


Figure 1: Resultant Interior Temperatures in the Original State. ET: Exterior Temperature, IT: Interior Temperature, RT: Resultant Temperature

ulation in the original situation and some data obtained from the building, such as the maximum and minimum temperature in a few days in which the weather conditions are known;

2. Evaluation of passive techniques by simulation.

The distribution of the load components as determined by S3PAS is shown in Table 3. Figure 1 shows the resultant interior temperatures in the Printing Works and in the Warehouse, together with the exterior temperature for reference purposes. A situation of obvious discomfort may be observed (maximum temperatures of 39.7°C in Warehouse and 41.5°C in the Printing Works), elimination of which is the purpose of this work.

4. Selection of Passive Cooling Techniques

Analysis of the thermal loads at constant interior temperature (Table 3) reveals that the principal load component is conduction via the roof. (In the Printing Works, the

greatest load is that of the equipment, but this component cannot be reduced). The cause of the high resultant temperatures is the high roof temperature.

In order to reduce heat transfer via conduction in general terms, and particularly via the roof, together with the interior surface temperature thereof, the following techniques may be utilised:

- a) Insulation of the exterior walls,
- b) Installation of a false ceiling beneath the roof,
- c) Insulation of the roof with 4 *cm* of insulation,
- d) Installation of an irrigation system on the roof,
- e) Installation of a false ceiling with 4 *cm* of insulation and mechanically ventilated.

Each measure was evaluated from the point of view of the thermal load at constant interior temperature with the S3PAS programme. Table 4 shows the maximum daily values of the total load and the maximum temperature obtained on the interior surface of the roof (or of the false ceiling when present). We can obtain the following conclusions:

1. The insulation of the exterior walls is not interesting, due to the low influence in the global load, and the high temperature at the inside surface of the ceiling. Furthermore, the cost of this operation is too high, as we will see later.
2. The installation of a false ceiling beneath the roof makes the load to be 16% lower. This is an interesting technique and will be incorporated in technique e), improving its performance.
3. Insulation of the roof with 4 *cm* of insulation reduces the thermal load in a 25%. The temperature of the interior surface of the ceiling becomes acceptable. But the reduction obtained is not high enough to omit an additional treatment. Furthermore, the sandwich roof is not easily insulated.
4. Installation of an irrigation system on the roof reduces the thermal load in a 47%, and the interior surface temperature drops to 27 °C . The exterior surface temperature is between 15 and 20 °C lower than before. This is a problematic solution because of the high water consumption (aprox. 0.75 m³/h), and the likely corrosion of the roof material.
5. The installation of a false ceiling ventilated and insulated with 4 *cm* of insulation reduces the thermal load in a 50% approximately and the maximum temperature of the interior surface of the ceiling is reduced to 26.5 °C . The implementation is easy and the operating cost is low. There is no water consumption, and its implementation does not need any additional 'conventional' system for air treatment.

5. The Passive Cooling Technique Installed

The last-mentioned technique, the installation of an insulated and ventilated false ceiling, has the advantage of being simple to install, requires no special maintenance and appears to be sufficient on its own to achieve the desired effects.

Figure 2 shows the free fluctuation of the temperature in the two areas following the installation of the proposed technique, technique e), obtained by simulation with

Table 4: Maximum Values of Total Load and Roof Temperature

Technique Simulated	Max. load (kW)	Reduction (%)	Maximum Temperature
initial situation	223	-	38
a	207	6.8	38
b	186	16.4	33
c	167	24.9	30
d	118	47.2	27
e	110	50.7	26.5

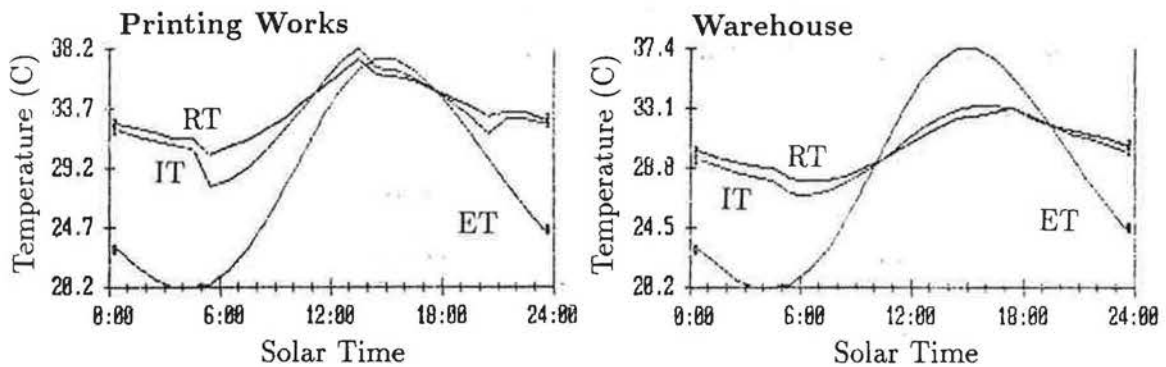


Figure 2: Resultant Interior Temperatures After Simulation of Technique e). ET: Exterior Temperature, IT: Interior Temperature, RT: Resultant Temperature

S3PAS. With respect to the initial values (Fig. 1), a reduction of 4°C in the resultant temperature in the Printing Works may be observed, and 6.5°C in the Warehouse.

Analysis of Figure 2 shows that the outdoor temperature is inferior to the inside temperature at night, so the resultant inside temperature could be reduced still further by ventilation of the building at night.

Figure 3 shows the temperatures obtained by simulation assuming forced ventilation for 6 renewals per hour at night-time. A reduction of the resultant temperature of an additional 1°C is achieved in the Warehouse and 4°C in the Printing Works.

This situation is better than the initial technique e, therefore technique e) with night ventilation was recommended for implementation in the building: An insulated false ceiling of 4 cm of glass fibre was installed, with spaces for translucent panels beneath the sky-lights, ventilated mechanically by means of a group of extractors located above the false ceiling on the SE wall. Renewal of the air is carried out via grilles situated at

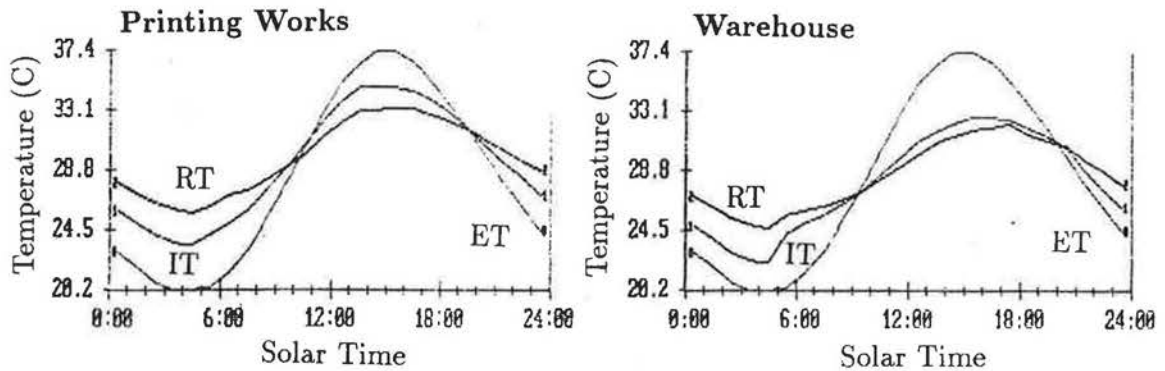


Figure 3: Resultant Interior Temperatures After Simulation of Technique e) plus Night Ventilation. ET: Exterior Temperature, IT: Interior Temperature, RT: Resultant Temperature

ground level in the SE wall.

The extractors will operate continually in the Printing Works. In the Warehouse, all the extractors will operate when the outside temperature is inferior to the inside temperature; otherwise only two of the extractors will operate to enable ventilation of the false ceiling without causing an excessive increase in the ventilation load of the building.

6. Monitoring of the Building

After implementation of the proposed technique, in the Summer of 1990, the two areas of the building were monitored.

The records obtained, for the four days starting on July-18th, are shown in Figures 4 and 5 for the Warehouse and Printing Works respectively. Maximum temperatures of 33 and 34 °C are seen, which are much lower than the original values. Furthermore, the values recorded are fully in accordance with those obtained by simulation with the S3PAS computer programme.

In this case, the mere use of insulation and ventilation is sufficient to reduce the temperature inside an industrial non-conditioned building. The S3PAS computer programme is sufficiently versatile to enable its usage as a building design and evaluation tool.

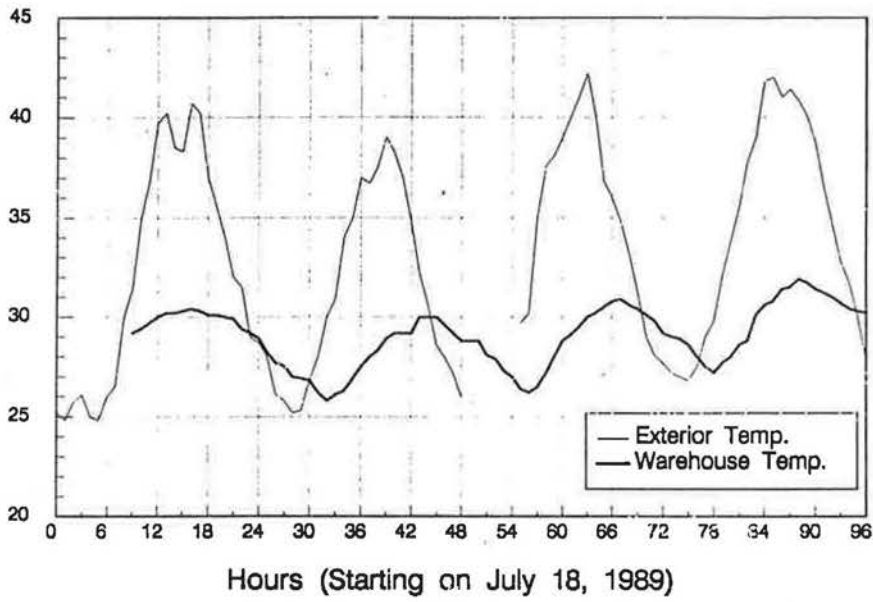


Figure 4: Recorded Exterior and Warehouse Interior Temperatures

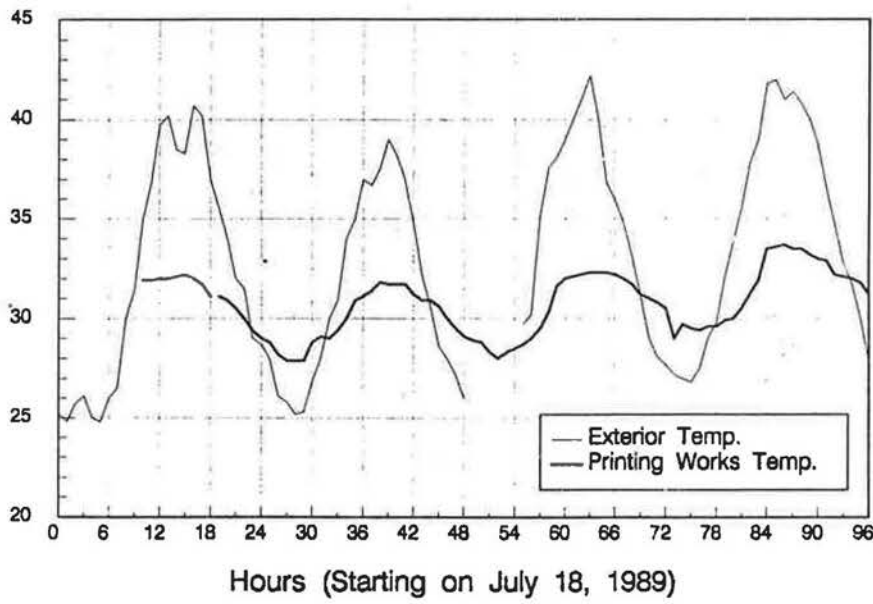


Figure 5: Recorded Exterior and Printing Works Interior Temperatures

References

- 1 Alvarez, S., Rodríguez E.A., Velázquez R. (1989) 'Thermal Performance of Passive Buildings Modelling and Simulation in the S3PAS Computer Program' in Proceedings of the 2nd European Conference on Architecture. Kluwer Academic Publishers, Paris, pp 416-418
- 2 Guerra, J.J., Molina, J.L. (1989) 'Estudio de Evacuación de Calor en Almacén Postventa de Construcciones Aeronáuticas S.A. Factoría San Pablo' Final Report. Cátedra de Termotecnia, Sevilla